


Linden County Water District Annual Water Quality Report

Newsletter

June 2020

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo ó hable con alguien que lo entienda bien.

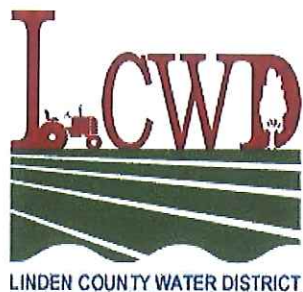

Board of Directors

Paul Brennan, President
David Fletcher, Vice President
Myron Blanton
Elaine Reed
Lawrence Knapp

Staff

JOHN VILLIERME
General Manager

JOE CHAVES
Operations Supervisor

MARTIN AMADOR
Operator In Training

BARBARA KASCHT
Office Manager /
Board Secretary

Inside this Issue:

Water Quality Data	Page 2
Water Quality Data	Page 3
Definitions and Abbreviations	Page 3
Important District Information	Page 4

Once again we proudly present our annual water quality report. We test the drinking water quality for many constituents as required by state and federal regulations. This report shows the results of our monitoring for the period of January 1 – December 31, 2019 and may include earlier monitoring data.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Linden's drinking water comes from two active wells located within the District's service area. Two additional wells are on standby status and are readily available for use during emergency situations.

Contaminants that may be present in source water include:

- *Microbial contaminants*, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- *Inorganic contaminants*, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- *Pesticides and herbicides*, that may come from a variety of sources such as agriculture, urban stormwater runoff and residential uses.
- *Organic chemical contaminants*, including synthetic and volatile organic chemicals, that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems.
- *Radioactive contaminants*, that can be naturally-occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the U.S. EPA and the State Board prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the U.S. EPA's Safe Drinking Water Hotline (1-800-426-4791).

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. U.S. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Linden County Water District is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. (If you do so, you may wish to collect the flushed water and reuse it for another beneficial purpose, such as watering plants.) If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (1-800-426-4791) or at <http://www.epa.gov/lead>.

Tables 1, 2, 3, 4, 5, and 6 list all of the drinking water contaminants that were detected during the most recent sampling for the constituent. The presence of these contaminants in the water does not necessarily indicate that the water poses a health risk. The State Board allows us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of the data, though representative of the water quality, are more than one year old. Any violation of an AL, MCL, MRDL or TT is asterisked. Additional information regarding the violation is provided later in this report.

TABLE 1 - SAMPLING RESULTS SHOWING THE DETECTION OF COLIFORM BACTERIA

Microbiological Contaminants	Highest No. of Detections	No. of months in violation	MCL	MCLG	Typical Source of Bacteria
Total Coliform Bacteria (state Total Coliform Rule)	(In a month) 0	0	1 positive monthly sample (a)	0	Naturally present in the environment
Fecal Coliform or <i>E. coli</i> (state Total Coliform Rule)	(In the year) 0	0	A routine sample and a repeat sample are total coliform positive, and one of these is also fecal coliform or <i>E. coli</i> positive		Human and animal fecal waste
<i>E. coli</i> (federal Revised Total Coliform Rule)	(In the year) 0	0	(b)	0	Human and animal fecal waste

(a) Two or more positive monthly samples is a violation of the MCL

(b) Routine and repeat samples are total coliform-positive and either is *E. coli*-positive or system fails to take repeat samples following *E. coli*-positive routine sample or system fails to analyze total coliform-positive repeat sample for *E. coli*.

TABLE 2 - SAMPLING RESULTS SHOWING THE DETECTION OF LEAD AND COPPER

Lead and Copper	No. of samples collected	90 th percentile level detected	No. sites exceeding AL	AL	PHG	Typical Source of Contaminant
Lead (ppb) 1-29-2019	12	<5.0 ug/L	0	15	0.2	Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits
Copper (ppm) 8-29-2017	10	0.0073 mg/L	0	1.3	0.3	Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives

Linden Unified School District requested to have Linden County Water District conduct lead sampling at two schools in 2019 (see above)

TABLE 3 - SAMPLING RESULTS FOR SODIUM AND HARDNESS

Chemical or Constituent (and reporting units)	Sample Date	Level Detected	Range of Detections	MCL	PHG (MCLG)	Typical Source of Contaminant
Sodium (ppm)	7-3-2019	11	0 - 11	none	none	Salt present in the water and is generally naturally occurring
Hardness (ppm)	7-3-2019	76	0 - 76	none	none	Sum of polyvalent cations present in the water, generally magnesium and calcium, and are usually naturally occurring

TABLE 4 - DETECTION OF CONTAMINANTS WITH A PRIMARY DRINKING WATER STANDARD

Chemical or Constituent (and reporting units)	Sample Date	Level Detected	Range of Detections	MCL [MRDL]	PHG (MCLG) [MRDLG]	Typical Source of Contaminant
Fluoride (ppm)	7-10-2018	.11	.11	2.0	1	Erosion of natural deposits; water additive which promotes strong teeth; discharge from fertilizer and aluminum factories
Barium (ppm)	7-10-2018	.078	.077 - .079	1	2	Discharge of oil drilling wastes and from metal refineries; erosion of natural deposits
Nitrate (as N) (ppm)	12-3-2019	.89	0.80 - 1.04	10	10	Runoff and leaching from fertilizer use; leaching from septic tanks and sewage; erosion of natural deposits

TABLE 5 - DETECTION OF CONTAMINANTS WITH A SECONDARY DRINKING WATER STANDARD

Chemical or Constituent (and reporting units)	Sample Date	Level Detected	Range of Detections	SMCL	PHG (MCLG)	Typical Source of Contaminant
Chloride (ppm)	7-3-2019	3.4	3.4	500	N/A	Runoff / leaching from natural deposits; seawater influence
Specific Conductance (micromhos)	7-3-2019	210	200 - 210	1,600	N/A	Substances that form ions when in water; seawater influence
Sulfate (ppm)	7-3-2019	3.2	3.2	500	N/A	Runoff/leaching from natural deposits; industrial wastes
Total Dissolved Solids (ppm)	7-3-2019	180	180	1,000	N/A	Runoff / leaching from natural deposits
Turbidity (ntu)	7-10-2018	0.12	0.10 - 0.13	5	N/A	Soil runoff

TABLE 6 - DETECTION OF UNREGULATED CONTAMINANTS

Chemical or Constituent (and reporting units)	Sample Date	Level Detected	Range of Detections	Notify Level	Health Effects Language
Vanadium (ppb)	11-3-05	8.95	7.9 - 10	50	The babies of some pregnant women who drink water containing vanadium in excess of the notification level may have an increased risk of developmental effects, based on studies in laboratory animals.

TERMS USED IN THIS REPORT:

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency (U.S. EPA).

Primary Drinking Water Standards (PDWS): MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

Secondary Drinking Water Standards (SDWS): MCLs for contaminants that affect taste, odor, or appearance of the drinking water. Contaminants with SDWSs do not affect the health at the MCL levels.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Regulatory Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

Variances and Exemptions: Permissions from the State Water Resources Control Board (State Board) to exceed an MCL or not comply with a treatment technique under certain conditions.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an *E. coli* MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

ND: not detectable at testing limit

ppm: parts per million or milligrams per liter (mg/L)

ppb: parts per billion or micrograms per liter (ug/L)

ppt: parts per trillion or nanograms per liter (ng/L)

ppq: parts per quadrillion or picogram per liter (pg/L)

pCi/L: picocuries per liter (a measure of radiation)

LINDEN COUNTY WATER DISTRICT
P.O. BOX 595
18243 E. HWY 26
LINDEN, CA 95236

PHONE: (209) 887-3216
WEBSITE: www.lindencwd.com
CONTACT: Barbara Kascht
bklingencwd@verizon.net

OFFICE HOURS:
Monday through Friday – 9:00 a.m. to 3:30 p.m.

PUBLIC WELCOME
Monthly Board Meetings
3rd Thursday of every month @ 6:00 p.m.
at the District Office

Working to Provide High Quality Services

Linden County Water District (LCWD) recognizes the importance of providing high-quality, reliable water and wastewater service to its customers, and that requires regular inspection, maintenance, and at times, replacement of its infrastructure. LCWD also has an obligation to meet state and federal regulations, which means a regular review of its capital improvement program (CIP) to ensure infrastructure meets or exceeds state and federal water and wastewater regulatory standards.

2019 Completed Infrastructure Improvements *Water and Sewer Lines Replacement Project*

This project involved upgrades to the District's water distribution and sewer collection systems. Approximately 1,100 feet of existing waterline was replaced with 8-inch C900 pipeline along HWY 26 from Orlando's to Market Street and included seven water services and two fire hydrants. The sewer line replacement included replacing approximately 1,400 feet of existing sewer mains and services on Duncan Road, Hwy 26, Market Street, and Cady Lane. The sewer mains were upgraded to either 6-inch or 8-inch SDR 35 pipe depending on location. The total project cost was \$584,000 and was successfully completed by D.A. Wood Construction.

CURRENT WATERING SCHEDULE

Even-numbered addresses water Tuesday, Thursday & Saturday.

Odd-numbered addresses water Monday, Wednesday & Friday.

No watering on Sunday.

No watering from 7:00 a.m. to 6:00 p.m.

Water no more than 30 minutes per station, per day.

No excessive water flow or run-off.

No washing down hard / paved surfaces.

No watering during / within 48 hours after measurable rainfall.

This provision does not apply to landscape irrigation zones that exclusively use very low flow drip type irrigation systems when no emitter produces more than 2 gallons of water per hour. This provision also does not apply to watering or irrigating by use of a hand-held bucket or similar container, a hand-held hose equipped with a positive self-closing water shut-off nozzle or device.

ENSURING GROUNDWATER FOR THE FUTURE

LCWD is partnering with 16 other groundwater sustainability agencies as part of the Eastern San Joaquin Groundwater Authority (ESJGA) to develop a Groundwater Management Sustainability Plan (GSP). GSPs are required for critically over-drafted basins as identified by the State. The ESJGA's developed GSP is currently under review by the State. While Linden does not have specific, immediate groundwater management projects identified in the GSP, it is still a partnering agency located within the boundaries of the ESJGA and as such, is responsible for a portion of the GSP development. LCWD's share of cost is approximately \$8,500 per year, which will be budgeted as part of the District's operational costs. This amount may fluctuate in future years. LCWD will continue to provide updates about the GSP as feedback is received from the State. Contact the District office at 887-3216 or visit www.esjgroundwater.org for more info.



Remember, the toilet is not a trashcan. Flushing the wrong things can cause problems in your plumbing, sewer, septic system, or at the District's wastewater treatment plant.

Please don't flush disinfecting wipes.

MISSION STATEMENT

The mission of the Linden County Water District is to strive to provide the safest and most dependable domestic water service and wastewater service to its constituents at the lowest and most efficient costs possible to enhance the quality of life for its citizens. We are a creation and extension of the people we serve. We are obligated to serve the public's interest throughout our functions.